


WN 056521-45632
07/09

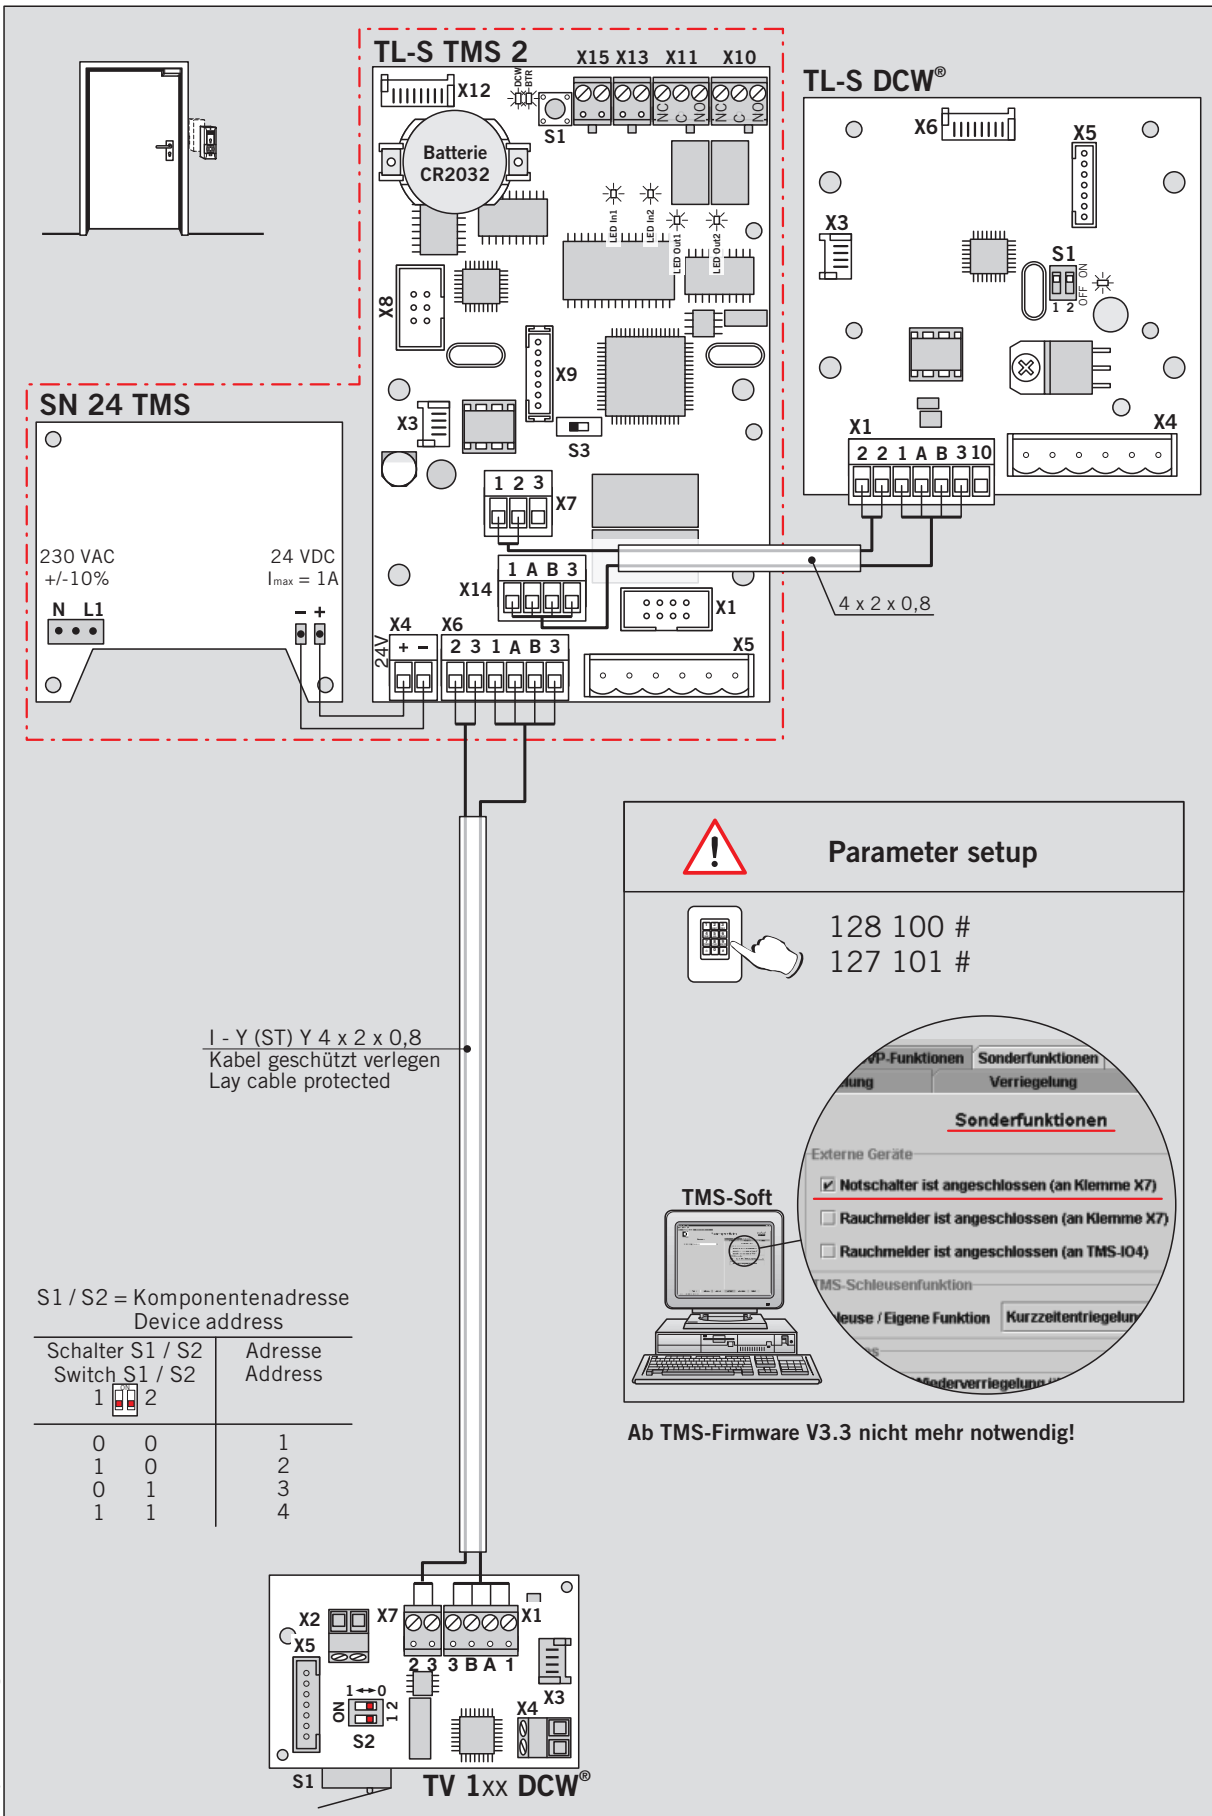

I - Y (ST) Y 4 x 2 x 0,8
Kabel geschützt verlegen
Lay cable protected

S1 / S2 = Komponentenadresse
Device address

Schalter S1 / S2 Switch S1 / S2	Adresse Address
1 0 2	
0 0	1
1 0	2
0 1	3
1 1	4

⚠ Parameter setup

128 100 #
127 101 #

TMS-Soft

Ab TMS-Firmware V3.3 nicht mehr notwendig!

Änderungen vorbehalten
Subject to change without notice