
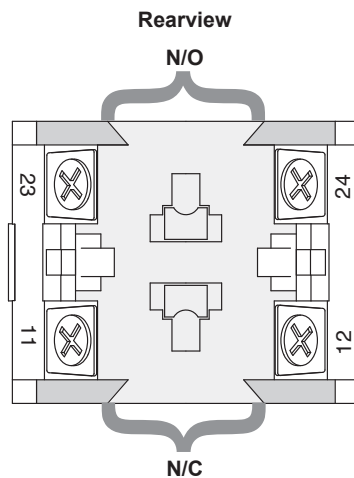


INSTALLATION

PBBH, PBRE, PBRR, PBKR PUSHBUTTONS

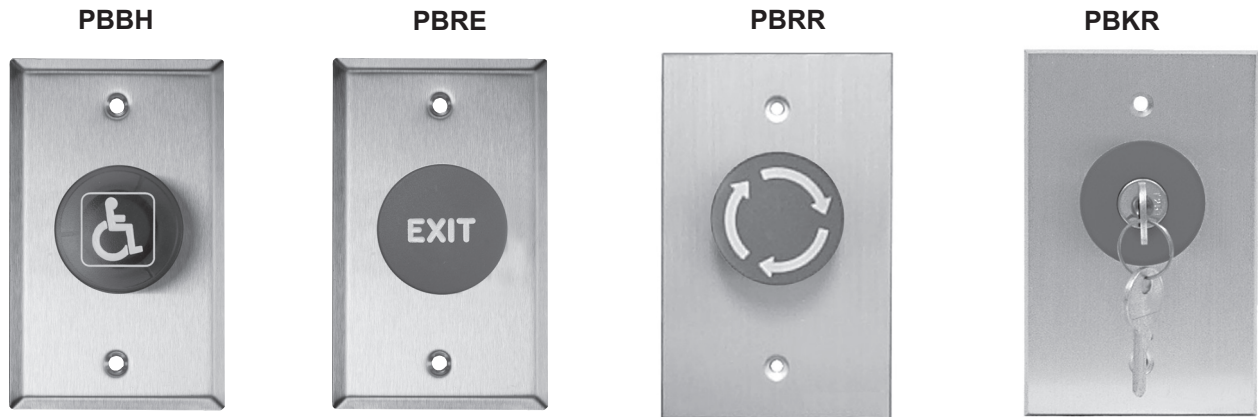

Description	Switch Mode	Switch Configuration	Rating for Switch or Timer	Button Label
PBBH Handicap	Momentary Action	1xSPST N/O & 1 SPST N/C	6A @24VDC cULus	Blue Cap with Handicap Symbol
EA Timer *	Adj. Delay 0.1-30 sec *	SPDT N/O & N/C	2A @30VDC	
EF Timer *	Fixed Delay 30 sec *	SPDT N/O & N/C	2A @30VDC	
PBBH Handicap	Maintained Action	1xSPST N/O & 1 SPST N/C	6A @24VDC cULus	Blue Cap with Handicap Symbol
PBRE Exit Button	Momentary Action	1xSPST N/O & 1 SPST N/C	6A @24VDC cULus	Red Cap with Exit wording
EA Timer *	Adj. Delay 0.1-30 sec *	SPDT N/O & N/C	2A @30VDC	
EF Timer *	Fixed Delay 30 sec *	SPDT N/O & N/C	2A @30VDC	
PBRE Exit Button	Maintained Action	1xSPST N/O & 1 SPST N/C	6A @24VDC cULus	Red Cap with Exit wording
PBRR Rotary Release	Maintained Action	1xSPST N/O & 1 SPST N/C	6A @24VDC cULus	Red Cap with Arrows
PBKR Key Release	Maintained Action	1xSPST N/O & 1 SPST N/C	6A @24VDC cULus	Red Cap

NOTE: Specifications are subject to change without notice. N/C – Normally Closed; N/O – Normally Open
 * Ordered and mounted separately.