


INSTALLATIONS

TD-30/TD-30A

30 Second Fixed and Adjustable Timers




Typical Installation for **TD-30A ADJUSTABLE RELOCK TIMER** with Fail Secure Strikes
TD-30A is adjustable from 0.1 - 30 seconds

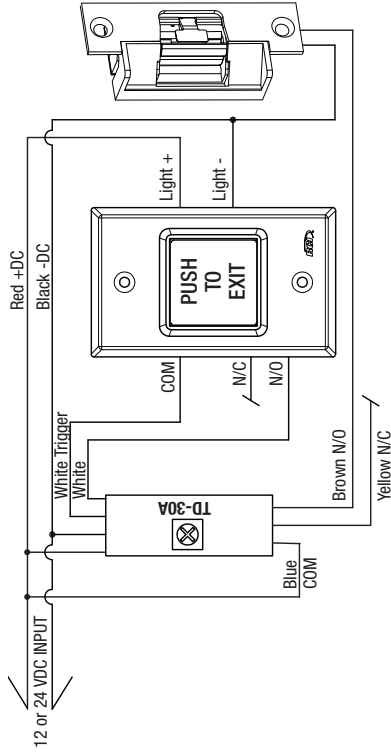

- Both timers are powered continuously
- Voltage for both timers is 12 to 24 VDC
- Each push on the exit button will restart the delay period.
- The trigger is connected to a N/O push button
- Double sided tape is provided to position the timer inside the switch junction box.

Typical Installation for **TD-30 FIXED RELOCK TIMER** with Electromagnetic Lock for Access Controlled Egress Doors with 30 Second Minimum Unlock Requirement

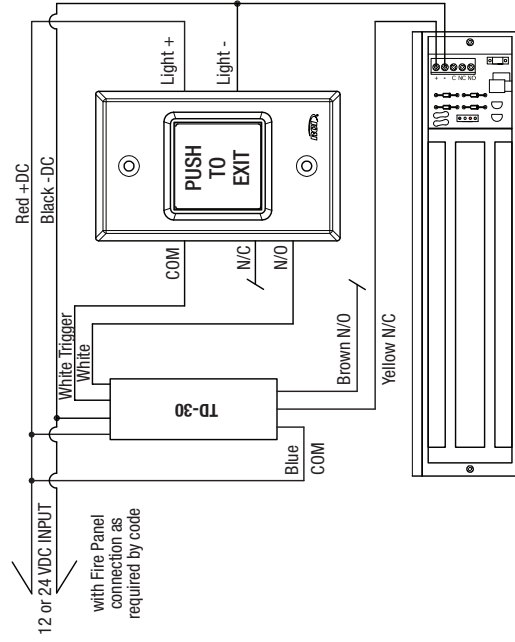


INSTALLATIONS

TD-30/TD-30A

30 Second Fixed and Adjustable Timers



Typical Installation for **TD-30A ADJUSTABLE RELOCK TIMER** with Fail Secure Strikes
TD-30A is adjustable from 0.1 - 30 seconds

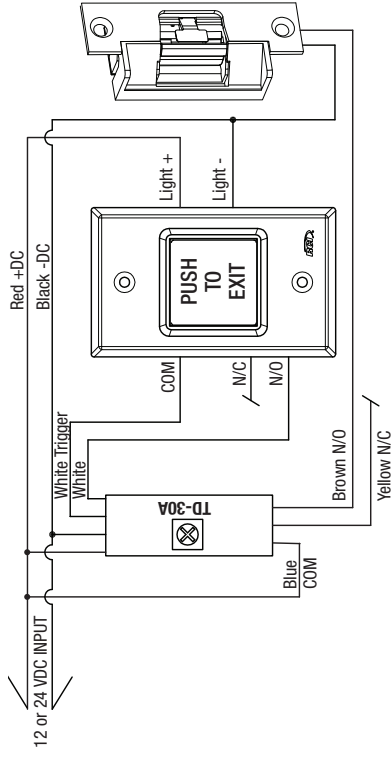

- Both timers are powered continuously
- Voltage for both timers is 12 to 24 VDC
- Each push on the exit button will restart the delay period.
- The trigger is connected to a N/O push button
- Double sided tape is provided to position the timer inside the switch junction box.

Typical Installation for **TD-30 FIXED RELOCK TIMER** with Electromagnetic Lock for Access Controlled Egress Doors with 30 Second Minimum Unlock Requirement

